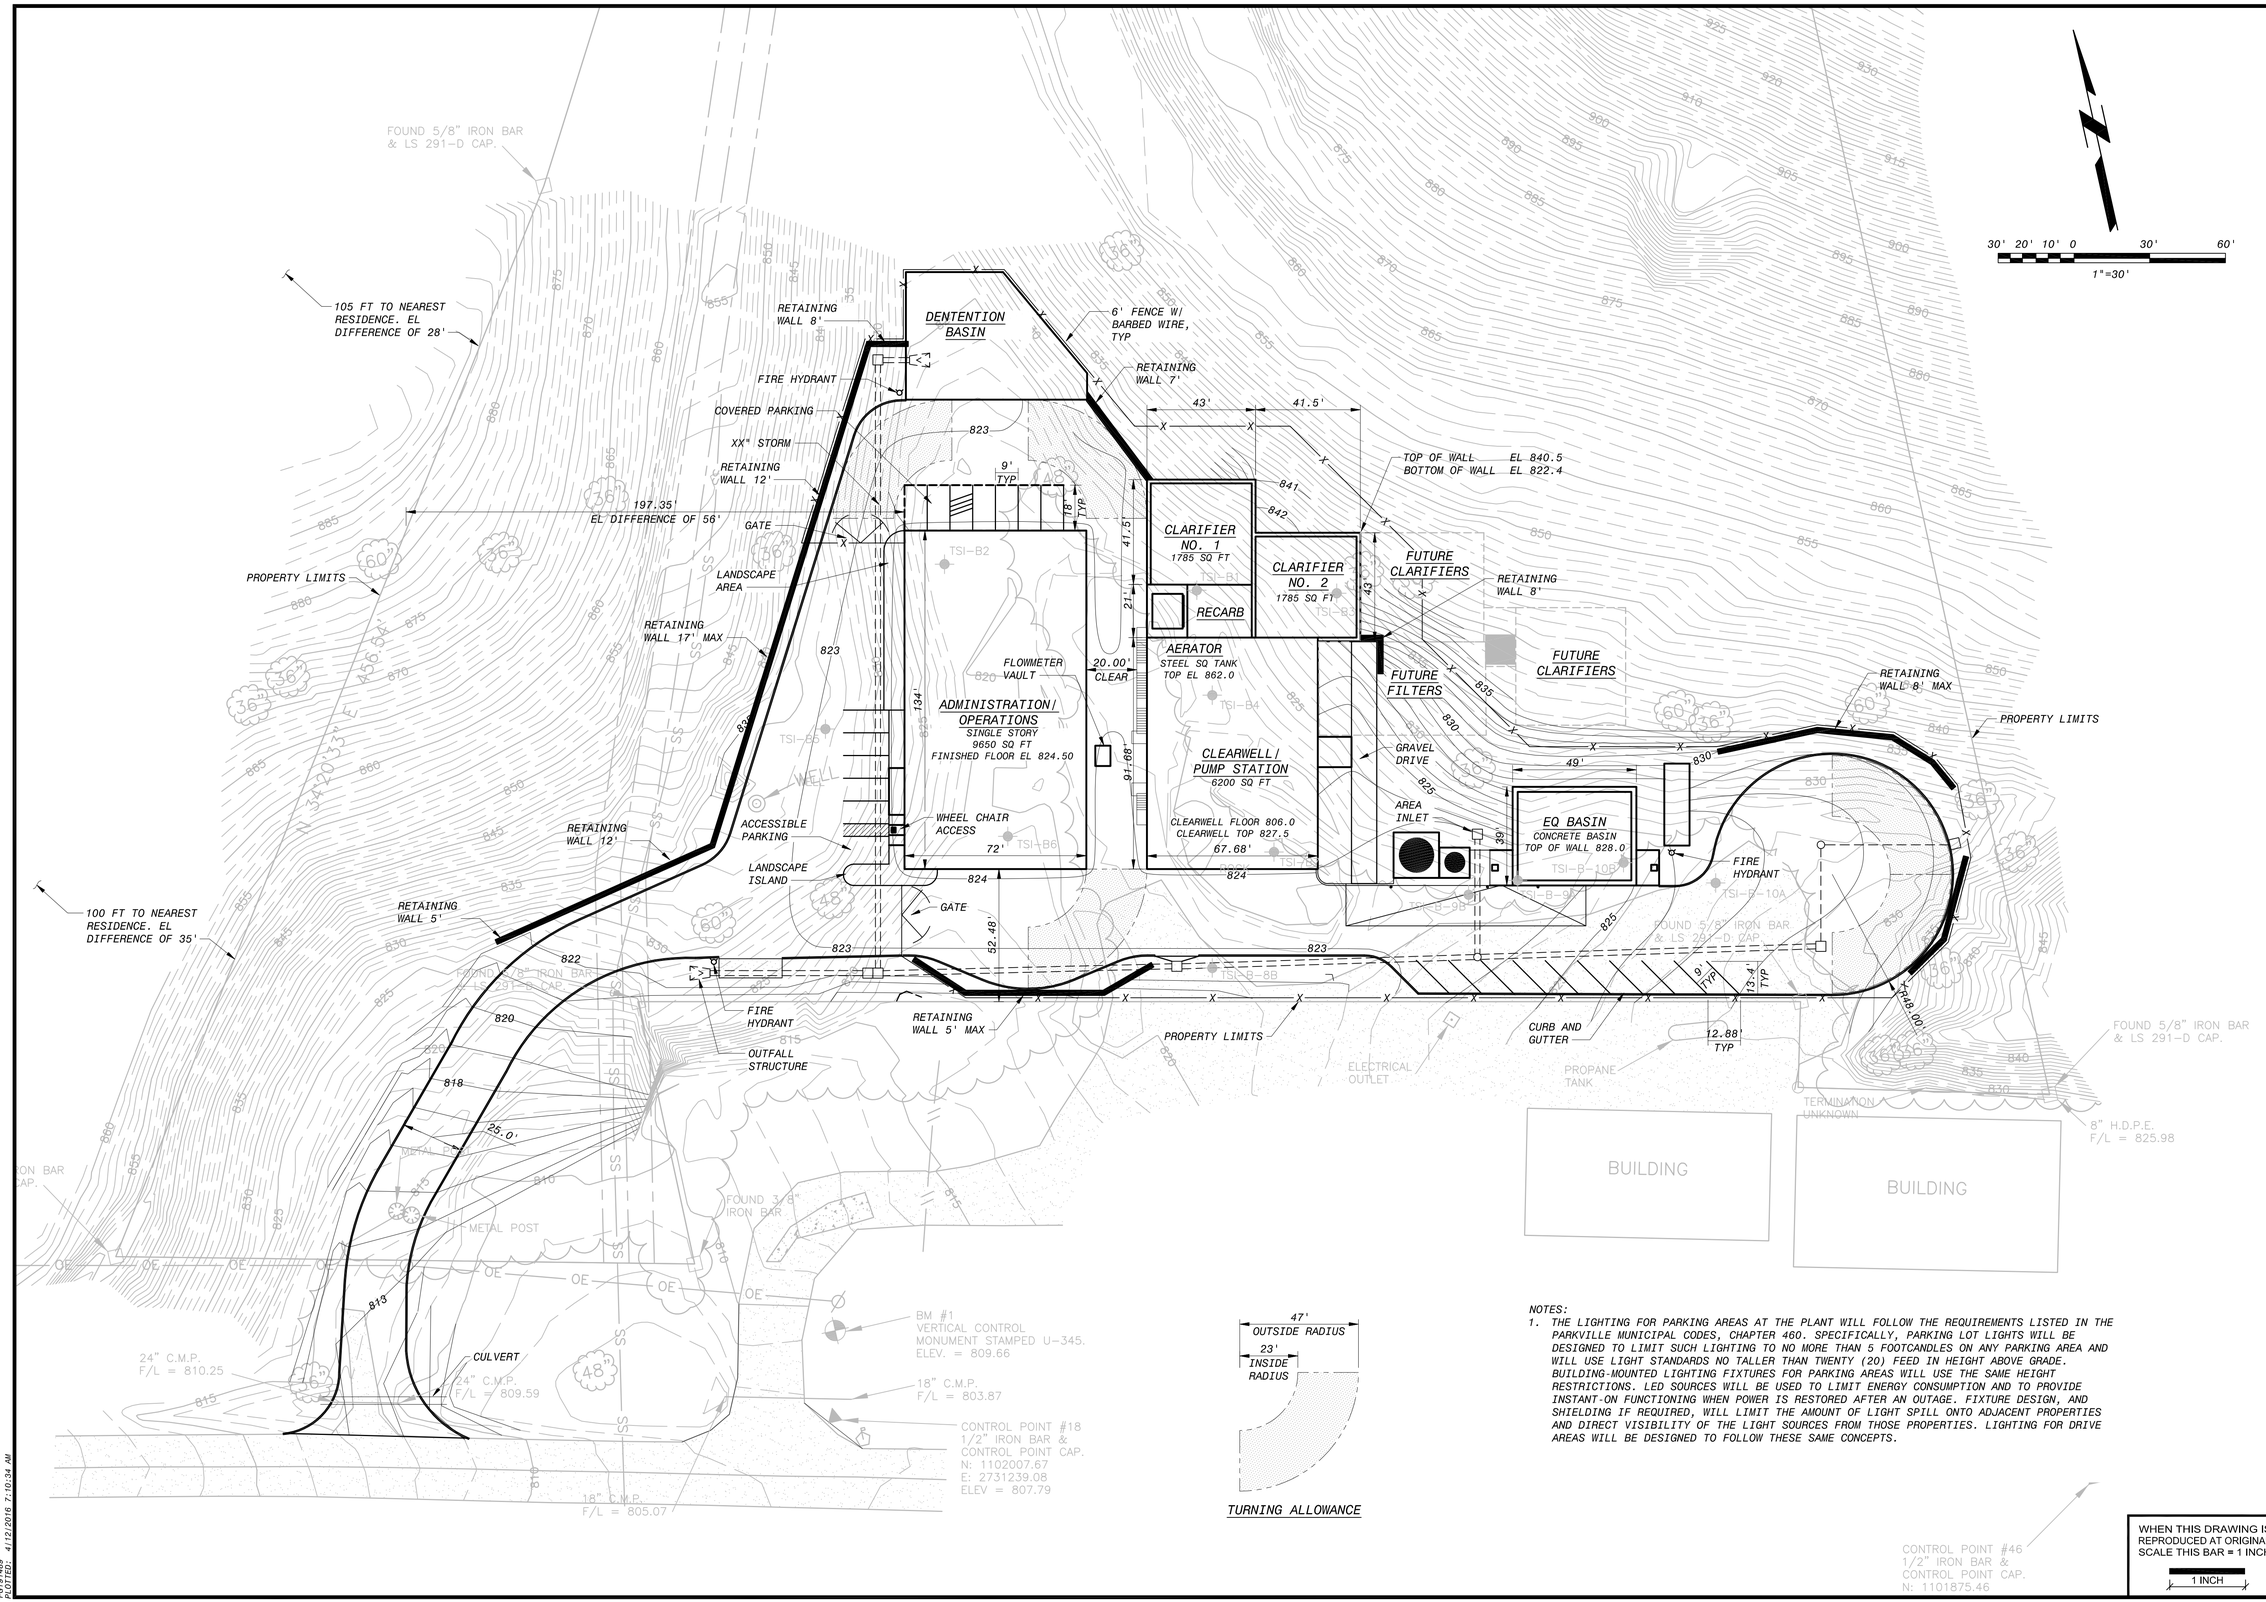

NOTES:

1. THE LIGHTING FOR PARKING AREAS AT THE PLANT WILL FOLLOW THE REQUIREMENTS LISTED IN THE PARKVILLE MUNICIPAL CODES, CHAPTER 460. SPECIFICALLY, PARKING LOT LIGHTS WILL BE DESIGNED TO LIMIT SUCH LIGHTING TO NO MORE THAN 5 FOOTCANDLES ON ANY PARKING AREA AND WILL USE LIGHT STANDARDS NO TALLER THAN TWENTY (20) FEED IN HEIGHT ABOVE GRADE. BUILDING-MOUNTED LIGHTING FIXTURES FOR PARKING AREAS WILL USE THE SAME HEIGHT RESTRICTIONS. LED SOURCES WILL BE USED TO LIMIT ENERGY CONSUMPTION AND TO PROVIDE INSTANT-ON FUNCTIONING WHEN POWER IS RESTORED AFTER AN OUTAGE. FIXTURE DESIGN, AND SHIELDING IF REQUIRED, WILL LIMIT THE AMOUNT OF LIGHT SPILL ONTO ADJACENT PROPERTIES AND DIRECT VISIBILITY OF THE LIGHT SOURCES FROM THOSE PROPERTIES. LIGHTING FOR DRIVE AREAS WILL BE DESIGNED TO FOLLOW THESE SAME CONCEPTS.

WHEN THIS DRAWING IS REPRODUCED AT ORIGINAL SCALE THIS BAR = 1 INCH

1 INCH

BLACK & VEATCH
Building a world of difference.
Black & Veatch Corporation
16305 Swingley Ridge Road, Suite 230 Chesterfield, MO, 63017
636.536.5800 Engineering License No. 1646

MISSOURI AMERICAN WATER
ENGINEER-DIRECT DEPARTMENT
727 CRAIG ROAD, ST. LOUIS, MISSOURI 63141

MISSOURI-AMERICAN WATER CO.
PARKVILLE DISTRICT
WATER TREATMENT PLANT
PARKVILLE, MO

PRELIMINARY NOT FOR CONSTRUCTION

PROFESSIONAL CERTIFICATION
I HEARBY CERTIFY THAT THIS DOCUMENT WAS PREPARED OR APPROVED BY

AND THAT I AM A DULY LICENSED PROFESSIONAL UNDER THE LAWS OF THE STATE OF MISSOURI
LICENSE NO:
EXPIRATION:

REVISIONS:

NO.	DATE	DESCRIPTION

DRAWN BY:
CHECKED BY:
FILE NO:
PROJ. NO.:
ISSUE DATE: 06/01/2016
DRAWING TITLE: CIVIL CONDITIONAL USE SITE PLAN
DRAWING NO.: CC01

F0101409
PLOTTED: 4/12/2016 7:10:34 AM